

1.8.6. APPLICATION OF FULL SPECTRUMS AND OTHER VIBRATION TWO-DIMENSIONAL CHARACTERISTICS FOR GAS TRANSPORTATION UNITS CONDITION MONITORING

Balitsky F.Ya, Sokolova A.G., Machinery Engineering Research Institute,
Russian Academy of Science, Moscow, Russia

It is well known fact that the more independent symptoms are using when machinery condition has to be defined the better is the diagnosis ultimately. At the paper is shown that application of combined full spectrum and orbit analysis technique permits to recognize unit defects which are not recognizable enough with using only common spectrum features. This condition monitoring tool was pioneered by Bently Nevada Co. specialists and needs to be applied more widely in vibration analysis due to its usefulness. The full spectrums are good instruments to investigate separate frequency components not only on their amplitude values but on precession direction as well to provide important diagnostic information. So, elliptical orbit form of filtered around definite speed ω vibration components can be presented [1] as a sum of the circle orbits pair: the first one goes along the shaft rotation direction (forward) with radius of R_{ω}^{+} and the second one – in opposite direction (reverse) with radius of R_{ω}^{-} , and these are just the full spectrum components in consideration. The mathematical equations for full spectrum components calculation are as follows:

Amplitude of forward precession at the circular frequency ω

$$R_{\omega}^{+} = [X_{\omega}^2 + Y_{\omega}^2 + 2X_{\omega}Y_{\omega}\sin(\alpha_{\omega} - \beta_{\omega})]^{1/2}; \quad (1)$$

amplitude of reverse precession at the circular frequency $-\omega$

$$R_{\omega}^{-} = [X_{\omega}^2 + Y_{\omega}^2 - 2X_{\omega}Y_{\omega}\sin(\alpha_{\omega} - \beta_{\omega})]^{1/2}, \quad (2)$$

where X_{ω} , α_{ω} and Y_{ω} , β_{ω} are ω -frequency components (amplitude and phase) of Fast Furie Transformation (FFT) of Horizontal X and Vertical Y relative vibrations respectively. Then precession direction (“forward” – as shaft rotate, or opposite one – called “reverse”) is easily defined by predominating spectral line from the pair R_{ω}^{+} and R_{ω}^{-} . And there is no need to view multiple filtered orbits plots with keyphasor marks, taken separately.

The full spectrum, unlike the common “half” spectrums of relative vibrations along each of two perpendicular directions, is a characteristic of some relationship between vertical Y and horizontal X vibration components, considered phase lag ($\alpha_{\omega} - \beta_{\omega}$) between them. Besides, it is possible to see the precession direction of each twofold spectral component from the plot, and that is very important for example in case if any available shaft rotation speed signal is absent.

The paper presents some results of journal supports vibration investigations to diagnose centrifugal force-pump operating status of gas transportation train when its state has deteriorated and bearing defects arisen and grown. As a matter of fact, there were some complicative accompanying factors: the standard monitoring system installed had returned only current (not averaged) spectrums and wave forms and had no keyphasor signal on its output.

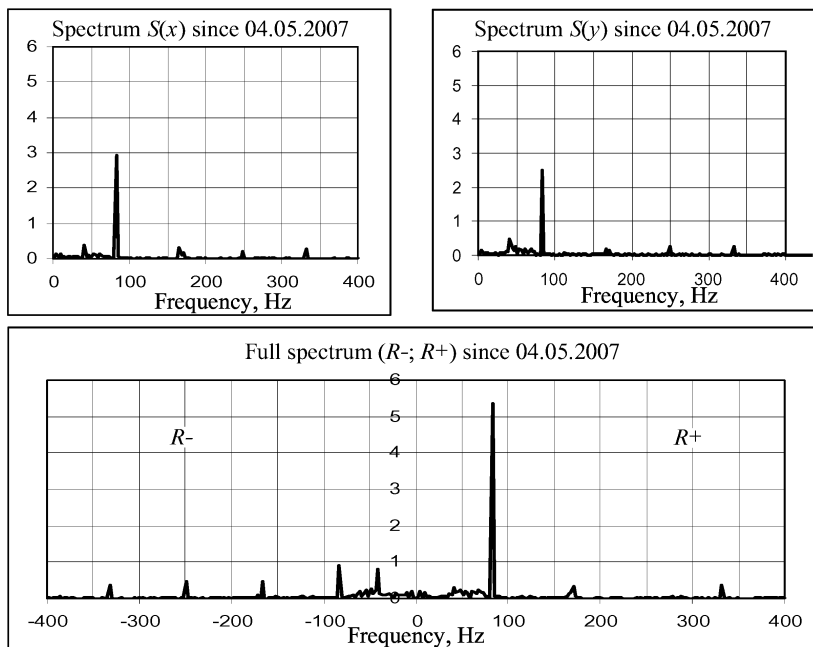


Fig. 1. Spectrums of horizontal $S(x)$ and vertical $S(y)$ relative vibrations of centrifugal force-pump field support (top) and corresponding full spectrum (bottom) seven days before machine emergency stoppage

At fig. 1 are presented processed field support relative data which had been obtained 8 days before an emergency breakdown of the unit. In the upper part of diagram the common spectrums $S(x)$ and $S(y)$ of horizontal and vertical vibrations respectfully are given, and one could see fundamental frequency components of shaft rotation $f_r = 87.5$ Hz and its low level harmonics and subharmonic ($0.5f_r$). Beneath is shown the full spectrum (R^- , R^+) plot within frequency band $-400 \dots +400$ Hz.

The symptom of residual imbalance of shaft is manifested at both spectrums type (and is emphasized at bottom picture with much bigger forward component f_r), but in full spectrum presentation there are obvious signs of light partial rub as well: subharmonic ($0.5f_r$) vibration has components both forward and reverse, and the last one is dominant. Presence of high harmonics are additional confirmation of the diagnosis.

Then, a day before the emergency stoppage of the engine due to failure of turbine gas generator roll bearing the spectrums had dramatically changed (fig. 2). The spectrum lines of $2/3f_r$ which emerged and became dominate in “half” spectrums are signs of partial rub, but only full spectrum gives us direct evidence of the defect due to there are about equal forward and reverse components of that frequency. This may be an effect of dry friction which accompanies the rub and oscillations amplification near natural frequency of the part. Presence of forward and reverse harmonics of f_r gives additional confirmation of the diagnosis.

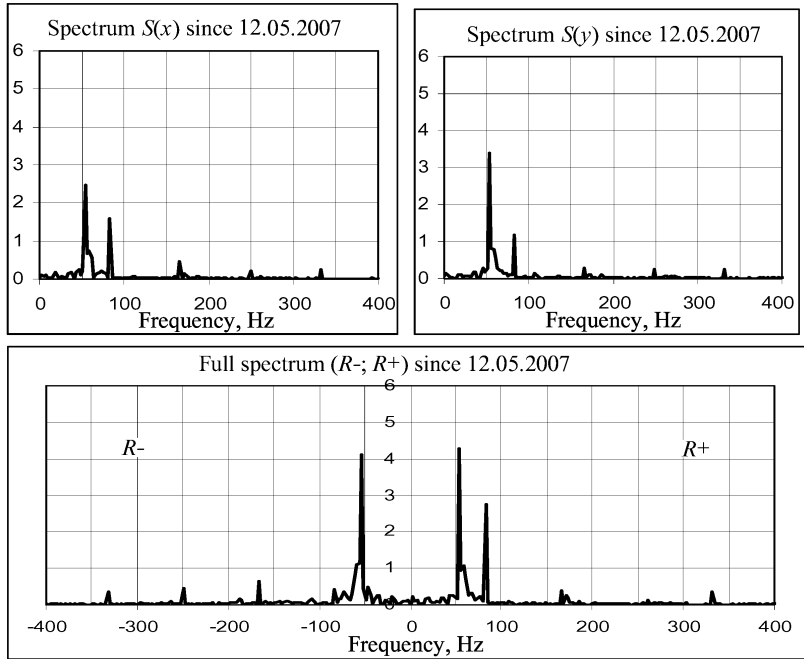


Fig. 2. Spectrums of horizontal $S(x)$ and vertical $S(y)$ relative vibrations of centrifugal force-pump field support (top) and corresponding full spectrum (bottom) one day before machine emergency stoppage

Plots of raw and filtered orbits corresponding to the “half” and full spectrums presented in the paper give the additional evidences of the diagnosis described.

Conclusions. The full spectrums are the power tool of relative vibration analyzing and present good and effective addition to other vibration features common used for condition monitoring, and could be recommended to more wide application. More than that, its calculation algorithm is simple and fast enough when FFT is using.